


PLAN

END SECTION

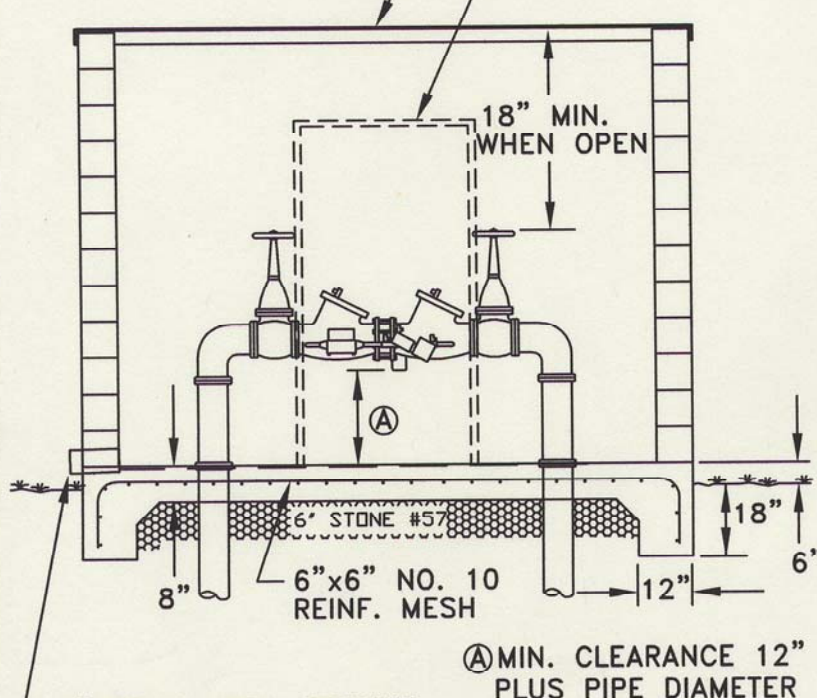

SIDE SECTION

NOTES

- * BACKFLOW DEVICE TO REMAIN ACCESSIBLE AT ALL TIMES.
- * TEST COCKS ARE TO BE PROVIDED WITH NIPPLES & CAPS.
- * STRAINER REQUIRED ON ALL DOMESTIC BACKFLOW DEVICES. (CHECK WITH FIRE MARSHALL FOR COMBINATION LINES).
- * THIS DRAWING INDICATES MINIMUM CLEARANCE AND ACCESS ONLY.
- * SECURITY PROCEDURES MAY BE DESIRABLE.
- * INSULATION/HEAT RECOMMENDED TO PREVENT FREEZING.
- * WALL CONSTRUCTION AND OUTSIDE FINISH IS OPTIONAL WITH OWNER.
- * RISING STEM VALVES (OS&Y) ARE TO BE INSTALLED ON ANY FIRE LINES.
- * REMOTE READER TO BE INSTALLED ON ALL DETECTOR BYPASS UNITS.
- * REMOTE READER TO BE INSTALLED THROUGH OUTSIDE WALL.

INSTALL ALL ITEMS ACCORDING TO MANUFACTURERS SPECIFICATIONS

METRO WATER SERVICES
BACKFLOW PREVENTER BOX
FOR 2-1/2" THROUGH 4"
(DOMESTIC & FIRE LINES)

Hal Balthrop
 LICENSED DISTRIBUTION OPERATOR

NOT TO SCALE DATE: 2/25/05
 DWG. NO. CDETF02

METRO
 WATER SERVICES

J. P. Little
 DIRECTOR OF WATER AND SEWERAGE SERVICES