


NOTE: MAINTAIN A MINIMUM OF 18" CLEARANCE AROUND ASSEMBLY

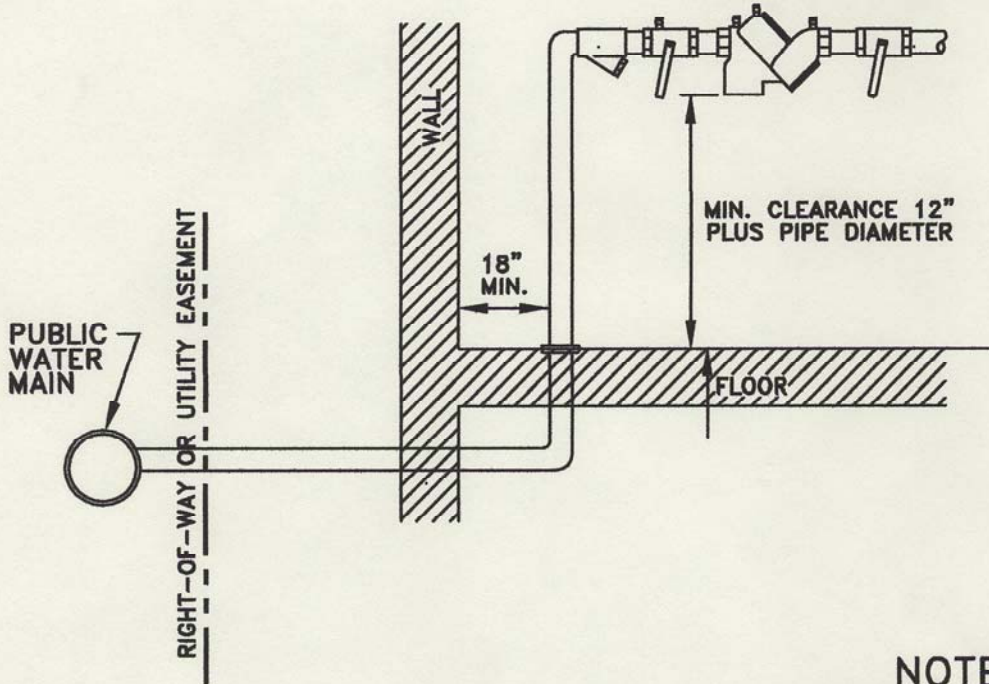

NOTES

- * BACKFLOW DEVICE TO REMAIN ACCESSABLE AT ALL TIMES.
- * TEST COCKS ARE TO BE PROVIDED WITH NIPPLES & CAPS.
- * STRAINER REQUIRED ON ALL DOMESTIC BACKFLOW DEVICES. (CHECK WITH FIRE MARSHALL FOR COMBINATION LINES).
- * THIS DRAWING INDICATES MINIMUM CLEARANCE AND ACCESS ONLY.
- * SECURITY PROCEDURES MAY BE DESIRABLE.

INSTALL ALL ITEMS ACCORDING TO
MANUFACTURERS SPECIFICATIONS

METRO WATER SERVICES

BACKFLOW PREVENTER INSIDE BUILDING
FOR 3/4" THROUGH 2" HORIZONTAL
VALVE ASSEMBLY

NOT TO SCALE | DATE: 7/7/04

DWG. NO. CDETBF08

METRO
WATER SERVICES

Hal Balthrop
LICENSED DISTRIBUTION OPERATOR

J. P. [Signature]

DIRECTOR OF WATER AND SEWERAGE SERVICES