
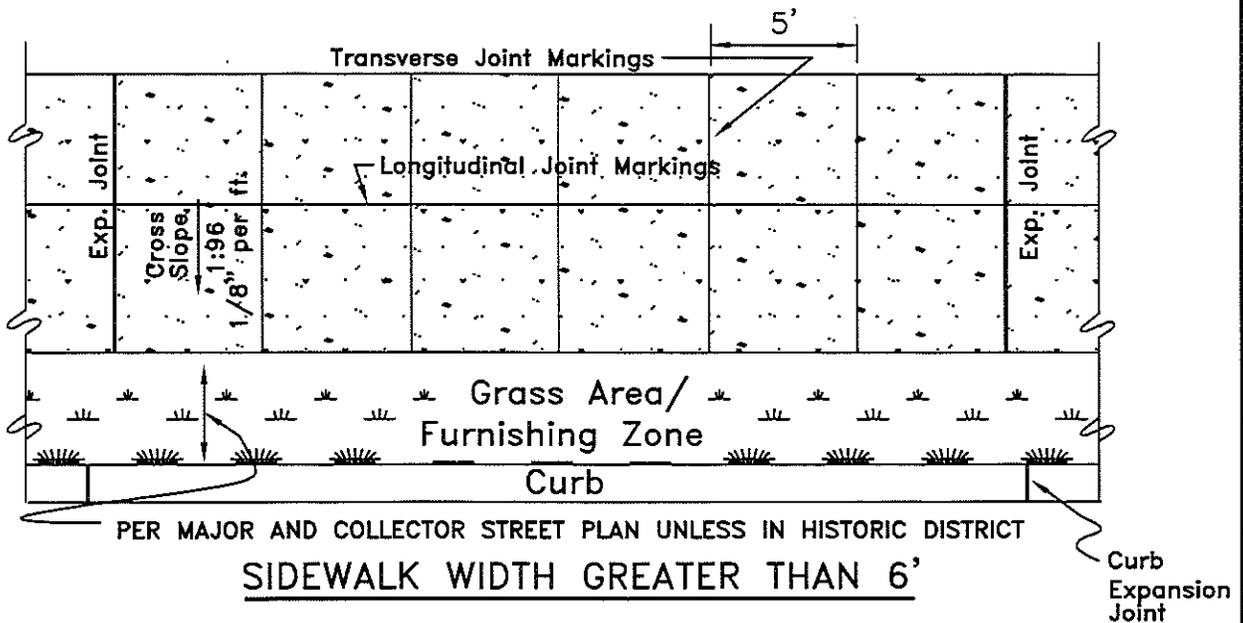


NOTE: EXPANSION JOINT TO BE SPACED 25' OR 30' APART DEPENDING ON TRANSVERSE JOINT MARKINGS OR AS DIRECTED BY THE ENGINEER TO MATCH EXISTING LAYOUT.

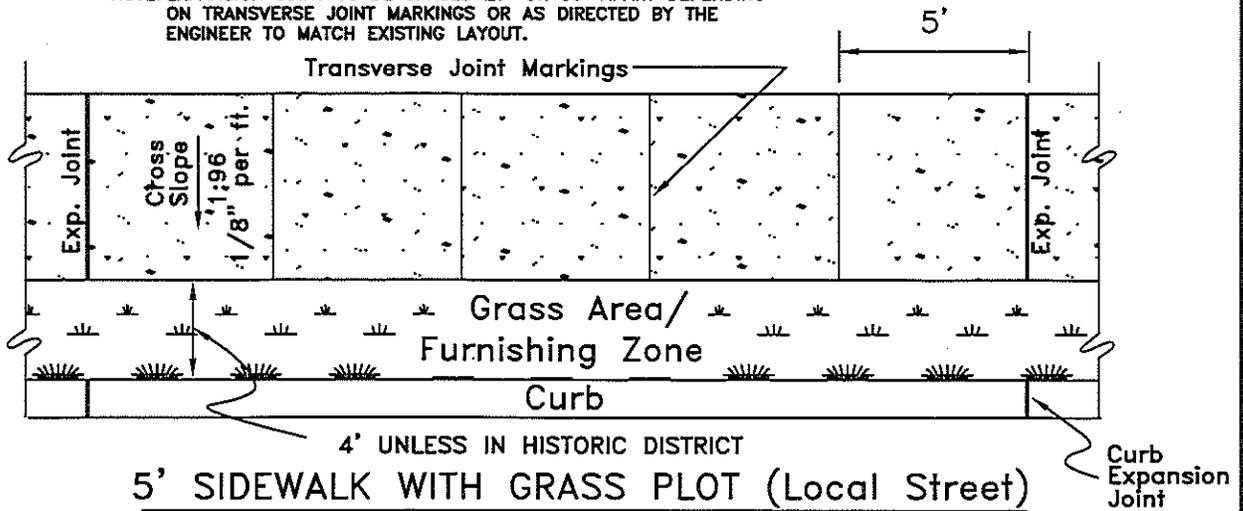

GENERAL NOTES

1. SIDEWALKS SHALL BE A MINIMUM OF 4 INCHES IN THICKNESS.
2. MAXIMUM CROSS SLOPE FOR SIDEWALKS SHALL NOT EXCEED 1:48 (VERTICAL:HORIZONTAL).
3. IN HISTORIC DISTRICTS THE STANDARD SHALL BE THE PREVAILING CHARACTERISTIC OF THE BLOCK FACE.
4. SIDEWALK SHALL BE CONSTRUCTED OF WHITE CONCRETE, BRICK, OR EXPOSED AGGREGATE PER METRO DEPARTMENT OF PUBLIC WORKS TECHNICAL SPECIFICATIONS, SECTION 02522.
5. IF APPROVED THE FURNISHING ZONE MAY CONTAIN HARDSCAPE MATERIALS SUCH AS CONCRETE, BRICK, OR PAVERS.
6. COMPACTED STONE BASE, PUG MILL MIX, 4" THICK SHALL BE APPLIED TO SUB GRADE PRIOR TO INSTALLING SIDEWALK.
7. FURNISHING ZONE IS AN AREA FOR OBSTRUCTIONS IN THE SIDEWALK. EXAMPLES ARE OUTDOOR CAFES, POWER POLES, FIRE HYDRANTS, SIGNS, ETC.
8. IN THE EVENT OF ANY CONFLICT, DISCREPANCY, OR INCONSISTENCY AMONG THE PLANS AND THESE STANDARD DETAILS, THE REQUIREMENTS OF THE STANDARD DETAILS SHALL GOVERN.

NTS

METROPOLITAN GOVERNMENT OF  
NASHVILLE AND DAVIDSON COUNTY  
DEPARTMENT OF PUBLIC WORKS

SIDEWALK  
CONSTRUCTION

DWG. NO. ST-210

DIR. OF ENG.:

*[Signature]*

DATE:

9/12/17

REVISED: 05/02/03

REVISED: 11/24/03

REVISED: 06/23/04

REVISED: 09/11/17