Exhibit 1

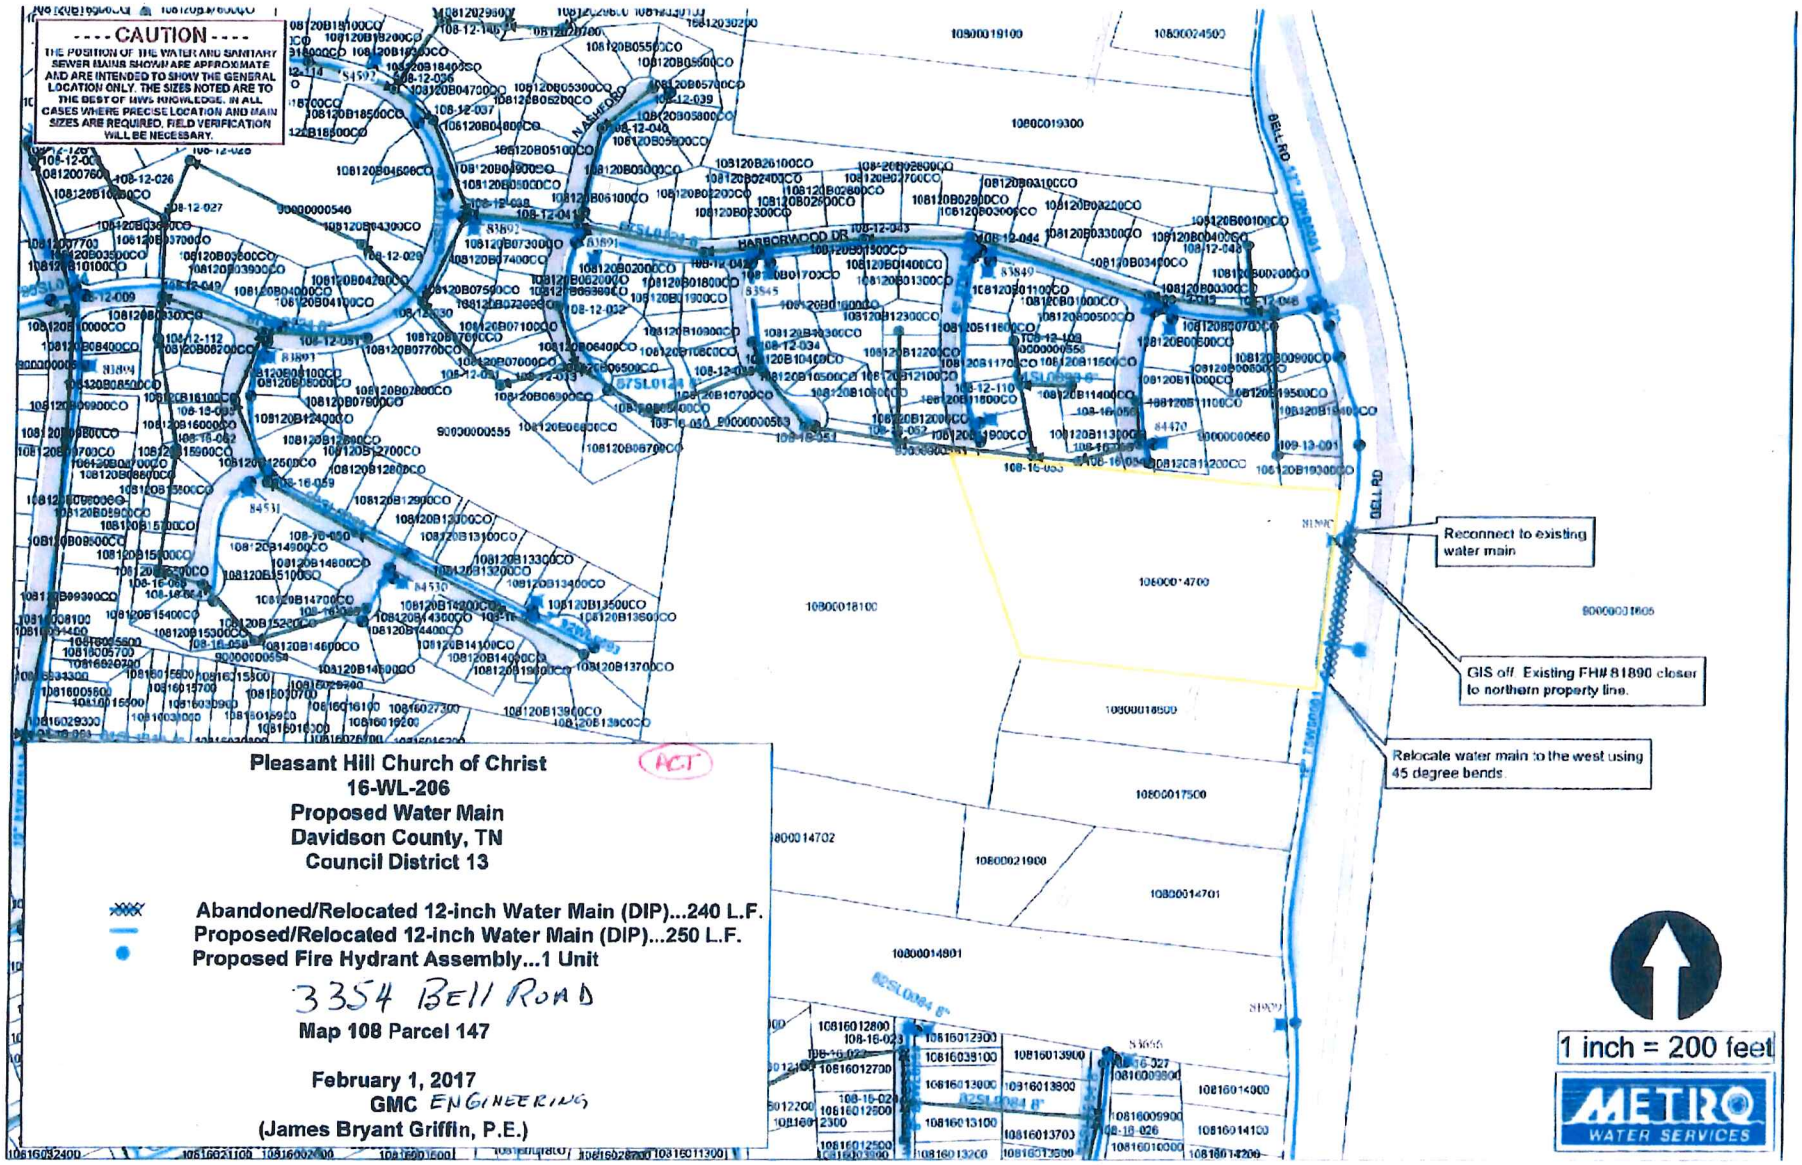
---- CAUTION ----
THE POSITION OF THE WATER AND SANITARY SEWER MAINS SHOWN ARE APPROXIMATE AND ARE INTENDED TO SHOW THE GENERAL LOCATION ONLY. THE SIZES NOTED ARE TO THE BEST OF MWS KNOWLEDGE. IN ALL CASES WHERE PRECISE LOCATION AND MAIN SIZES ARE REQUIRED, FIELD VERIFICATION WILL BE NECESSARY.
HARBORWOOD DR
BELL RD
Reconnect to existing water main
GIS off. Existing FH# 81890 closer to northern property line.
Relocate water main to the west using 45 degree bends.
Pleasant Hill Church of Christ
16-WL-206
Proposed Water Main
Davidson County, TN
Council District 13
Abandoned/Relocated 12-inch Water Main (DIP)...240 L.F.
Proposed/Relocated 12-inch Water Main (DIP)...250 L.F.
Proposed Fire Hydrant Assembly...1 Unit
3354 Bell Road
Map 108 Parcel 147
February 1, 2017
GMC Engineering
(James Bryant Griffin, P.E.)
1 inch = 200 feet
METRO WATER SERVICES