


CAUTION
 THE POSITION OF THE WATER AND SANITARY SEWER MAINS SHOWN ARE APPROXIMATE AND ARE INTENDED TO SHOW THE GENERAL LOCATION ONLY. THE SIZES NOTED ARE TO THE BEST OF OUR KNOWLEDGE. IN ALL CASES WHERE PRECISE LOCATION AND MAIN SIZES ARE REQUIRED, FIELD VERIFICATION WILL BE NECESSARY.

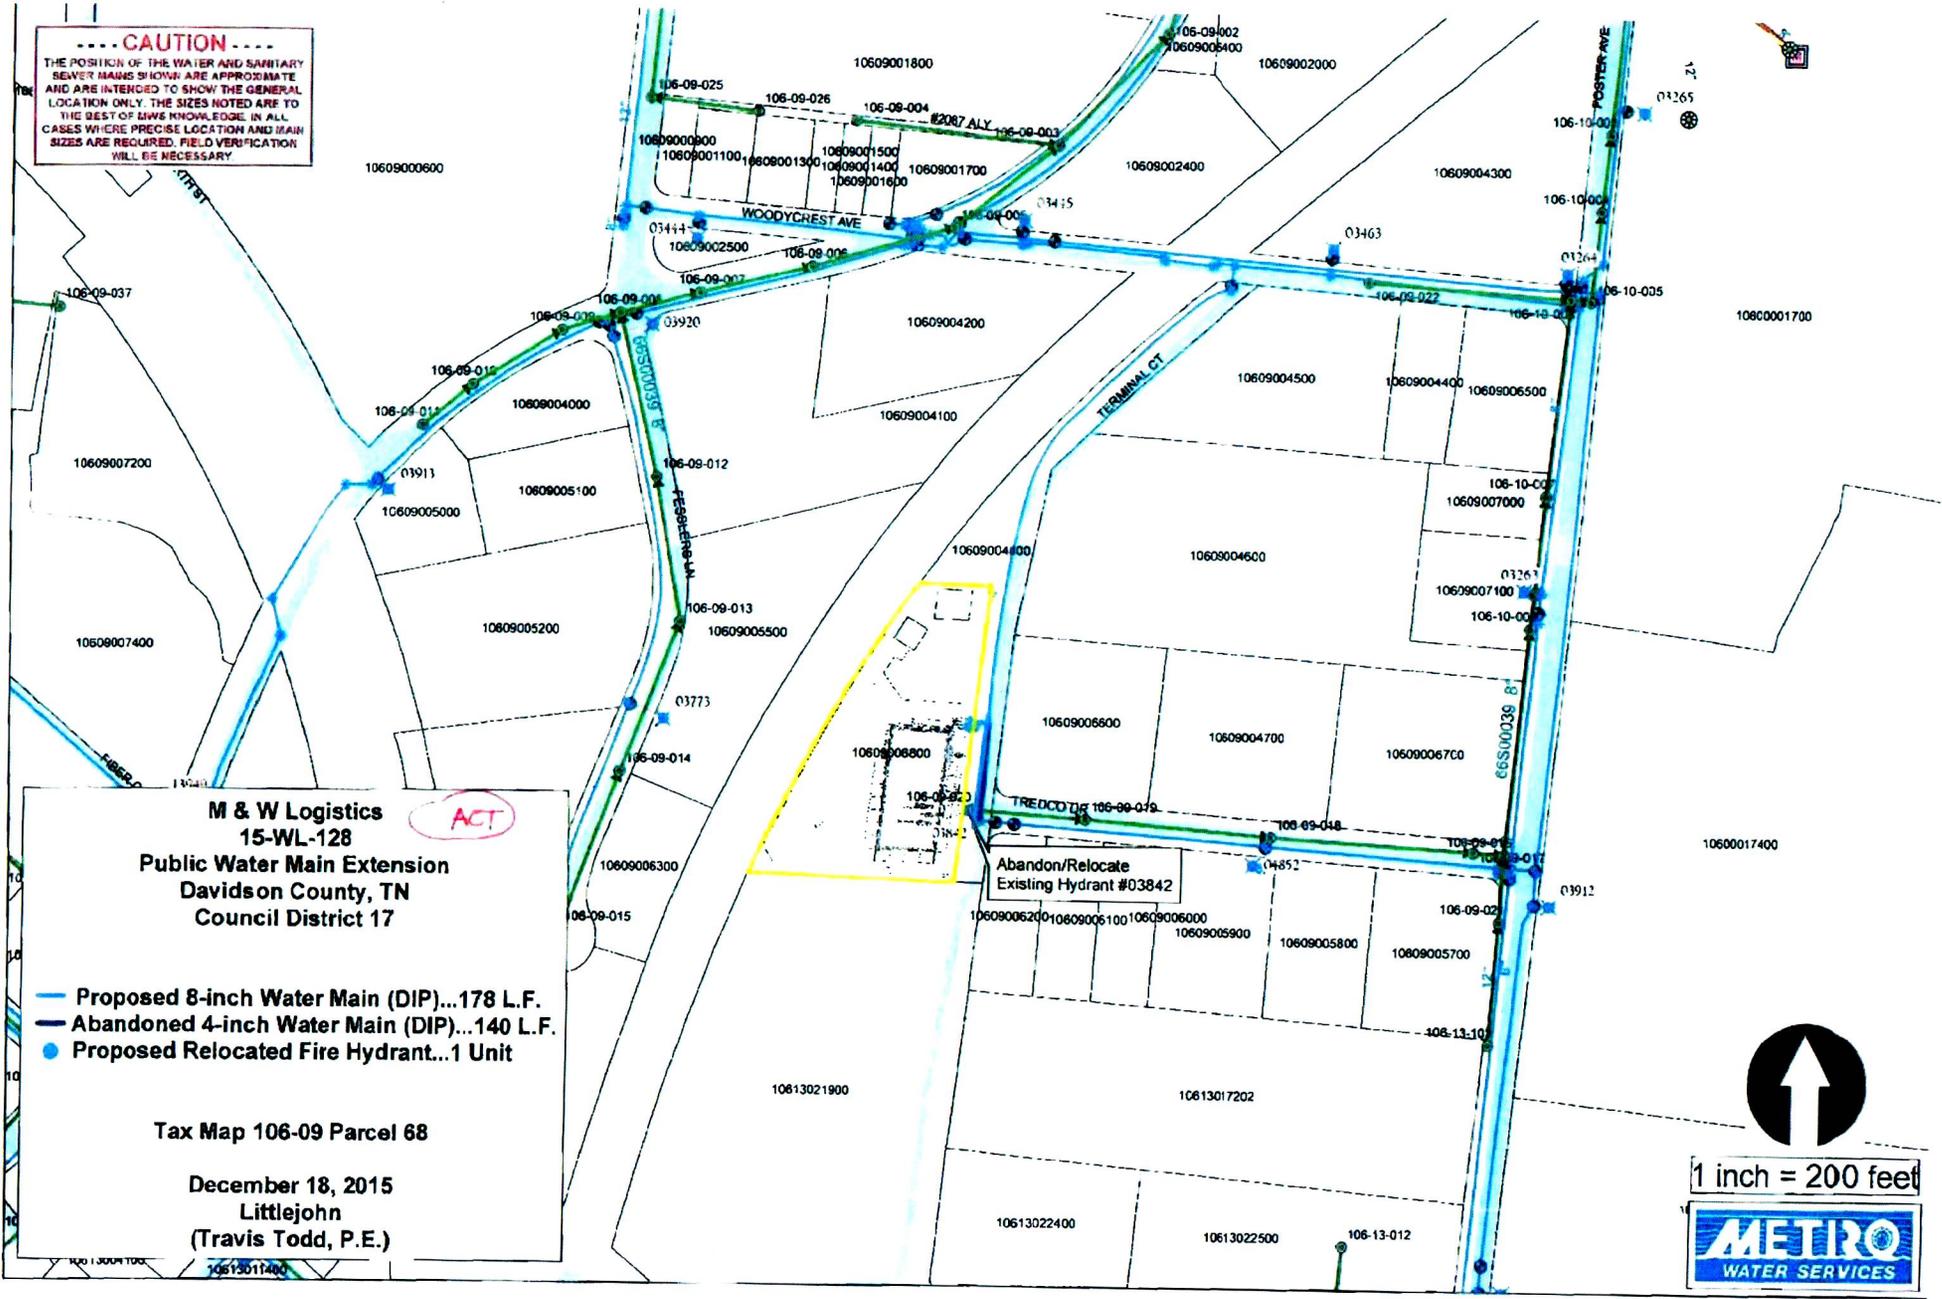

M & W Logistics
 15-WL-128
 Public Water Main Extension
 Davidson County, TN
 Council District 17

ACT

— Proposed 8-inch Water Main (DIP)...178 L.F.
 — Abandoned 4-inch Water Main (DIP)...140 L.F.
 ● Proposed Relocated Fire Hydrant...1 Unit

Tax Map 106-09 Parcel 68

December 18, 2015
 Littlejohn
 (Travis Todd, P.E.)

Abandon/Relocate
 Existing Hydrant #03842

1 inch = 200 feet