Exhibit 1

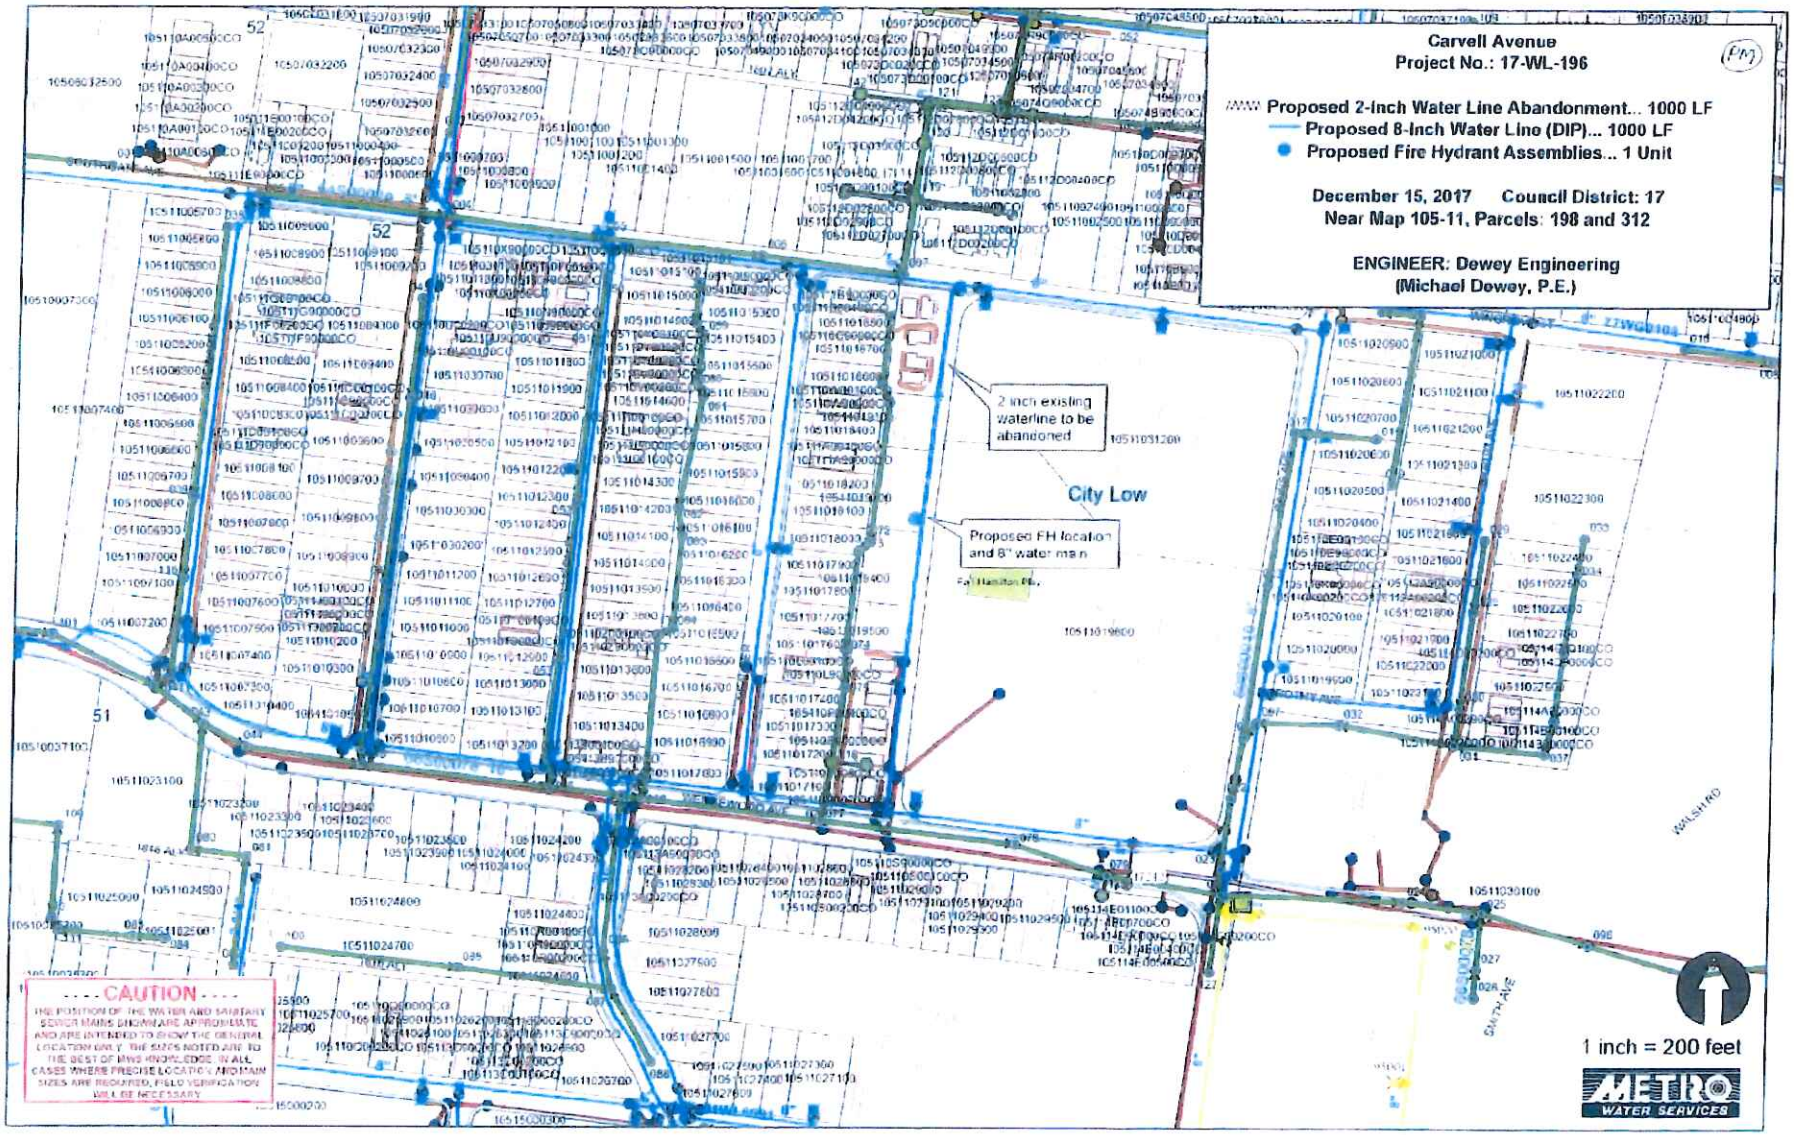
Carvell Avenue
Project No.: 17-WL-196
Proposed 2-Inch Water Line Abandonment... 1000 LF
Proposed 8-Inch Water Line (DIP)... 1000 LF
Proposed Fire Hydrant Assemblies... 1 Unit
December 15, 2017 Council District: 17
Near Map 105-11, Parcels: 198 and 312
ENGINEER: Dewey Engineering
(Michael Dewey, P.E.)
2 inch existing waterline to be abandoned
City Low
Proposed FH location and 8" water main
CAUTION
THE POSITION OF THE WATER AND SANITARY SEWER MAINS SHOWN ARE APPROXIMATE AND ARE INTENDED TO SHOW THE GENERAL LOCATION ONLY. THE SIZES NOTED ARE TO THE BEST OF MWS KNOWLEDGE. IN ALL CASES WHERE PRECISE LOCATION AND MAIN SIZES ARE REQUIRED, FIELD VERIFICATION WILL BE NECESSARY
1 inch = 200 feet
METRO WATER SERVICES