


NOTE: CASTING FOR STANDARD CURB AND GUTTER SHOWN (DR-129). ACCEPTABLE SUBSTITUTES WHERE USE IS DIRECTED ARE DR-130, DR-132, AND DR-133.

A MIN. OF 3 BRICK ADJUSTMENT COURSES

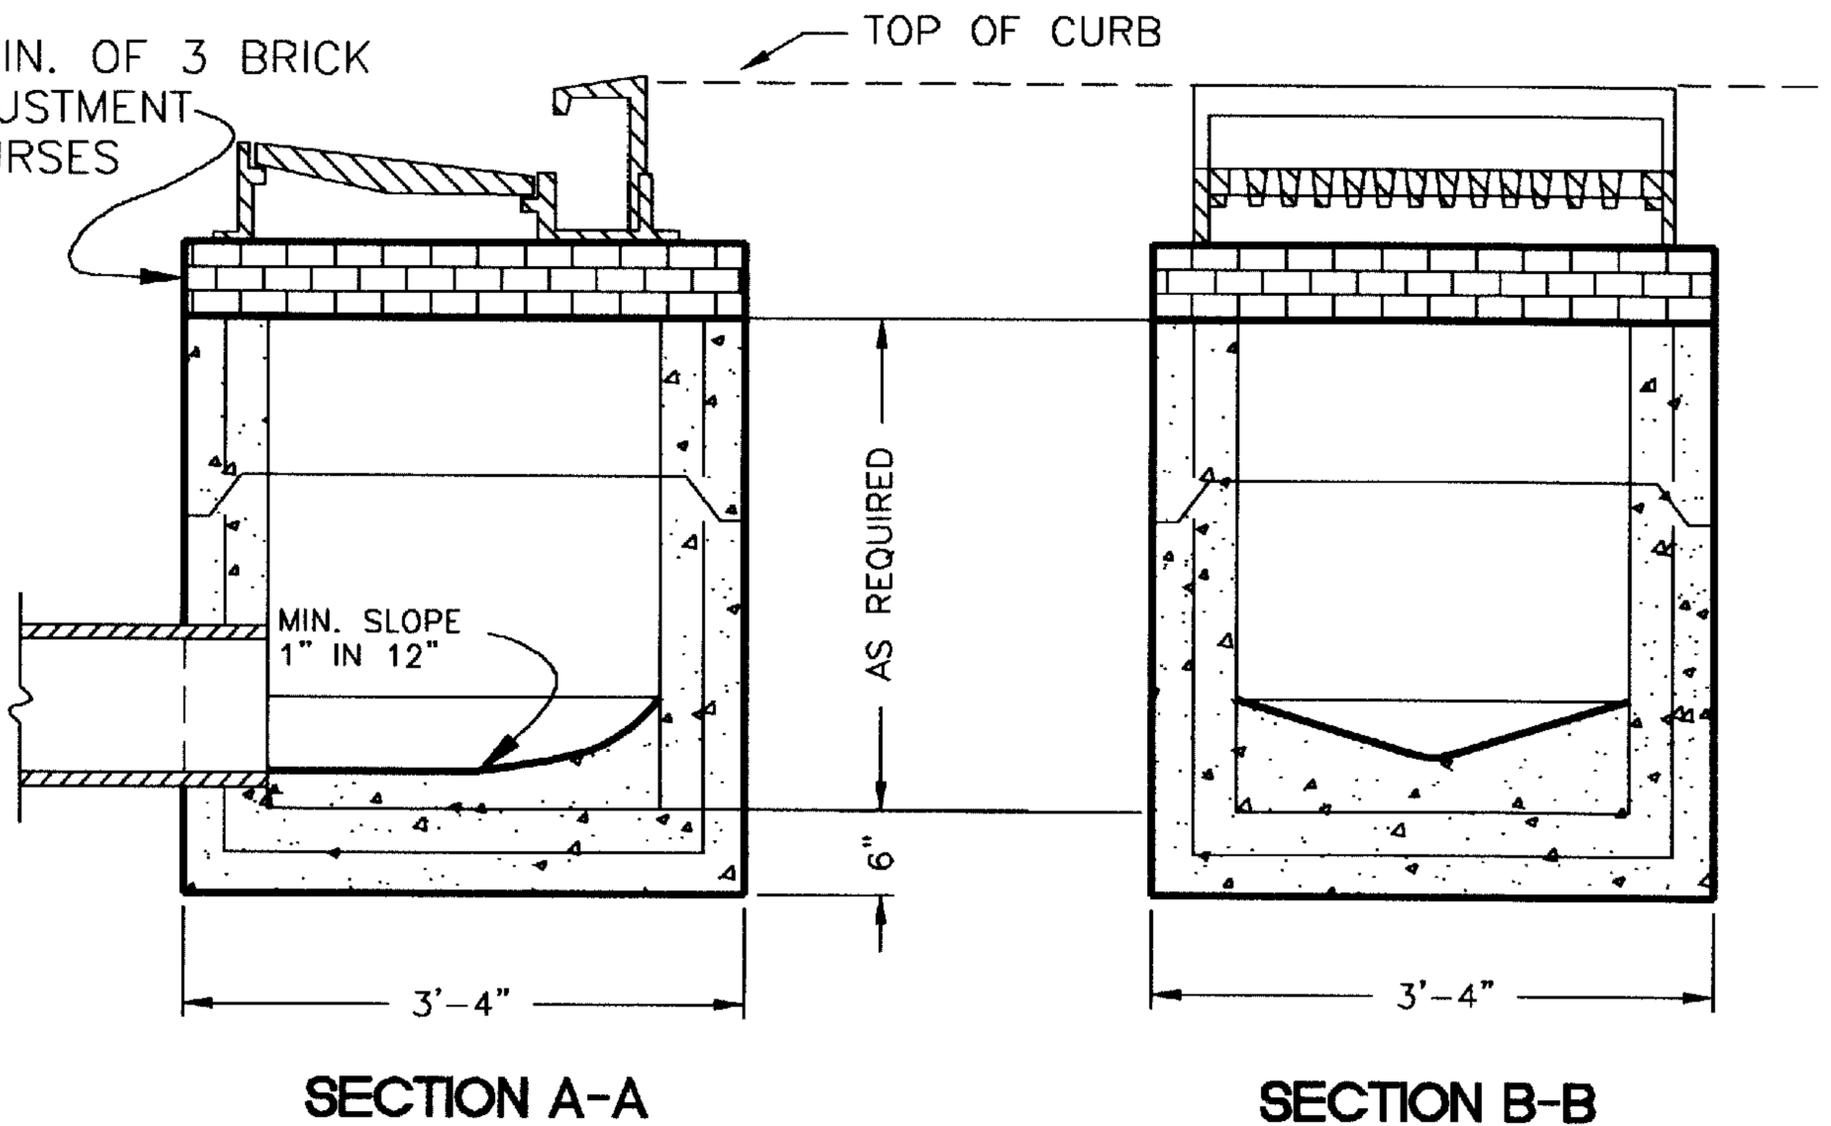

CONCRETE: 4000 PSI AT 28 DAYS
 MIN. REINFORCEMENT: 0.14 SQ. IN/SQ. FT.
 GRADE 60 STEEL.

NOT TO SCALE

METROPOLITAN GOVERNMENT OF NASHVILLE AND DAVIDSON COUNTY
 DEPARTMENT OF PUBLIC WORKS

SINGLE INLET
 (PRECAST)

DWG. NO. DR-105

ASST. DIR. ENG: *[Signature]*
 DIRECTOR: *[Signature]*

DATE: *3/1/00*
 DATE: *3/14/00*

REVISED: 02/08/00