



5' CLEARENCE FROM TREES, WALLS  
POLES, DRIVEWAYS, ETC.

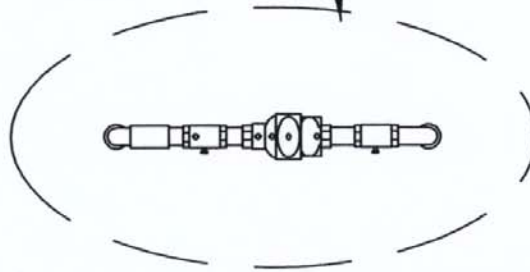

PLAN

NOTES

- \* BACKFLOW DEVICE TO REMAIN ACCESSABLE AT ALL TIMES.
- \* TEST COCKS ARE TO BE PROVIDED WITH NIPPLES & CAPS.
- \* STRAINER REQUIRED ON ALL DOMESTIC BACKFLOW DEVICES. (CHECK WITH FIRE MARSHALL FOR COMBINATION LINES).
- \* THIS DRAWING INDICATES MINIMUM CLEARANCE AND ACCESS ONLY.
- \* INLET PIPING MUST BE OF COPPER, BRASS AND/OR DUCTILE IRON.
- \* BACKFLOW SHOULD BE DRAINED DURING FREEZING WATHER OR ENCLOSED WITH BRICK OR ALUMINUM BOX.

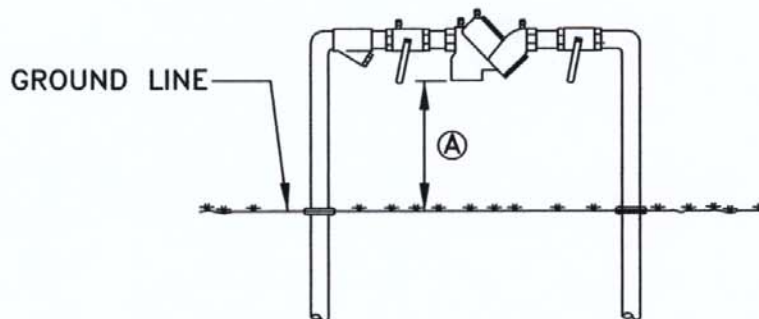

Ⓐ MIN. CLEARANCE 12"  
PLUS PIPE DIAMETER

SIDE SECTION

**METRO WATER SERVICES**  
**BACKFLOW PREVENTER FOR**  
**3/4" AND 1" IRRIGATION LINES**  
**WITH CLEARENCE ZONE**

NOT TO SCALE | DATE: 07/10/08  
DWG. NO. CDETBF09

**METRO**  
WATER SERVICES

*Hal Balthrop*  
LICENSED DISTRIBUTION OPERATOR

*W. H. H.*  
WATER SERVICES DIRECTOR

*Stephen S. Hyland*  
FIRE CHIEF

*[Signature]*  
CODES ADMINISTRATION DIRECTOR

*Richard Bennett*  
PLANNING EXECUTIVE DIRECTOR