


PLAN VIEW

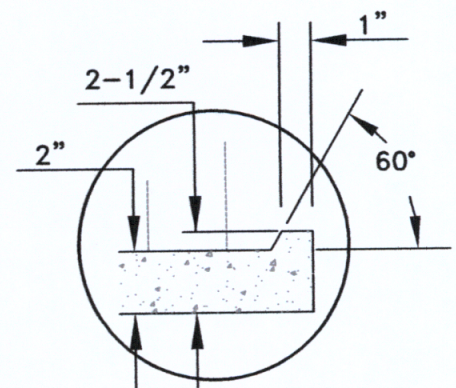

PAD EDGE ENLARGEMENT

METER BOX CONCRETE PAD

NOTES:

- (A) 4500 PSI CONCRETE SHALL BE USED
- (B) ALL CONCRETE SIDEWALLS TO BE REINFORCED WITH 6x6x6 (6x6-W2.9xW2.9) WIRE MESH CENTERED.

METRO WATER SERVICES

STANDARD METER BOX
CONCRETE PAD

NOT TO SCALE | DATE: 11/08/13

DWG. NO. WDET02A3



Hal Balthrop
LICENSED DISTRIBUTION SYSTEM OPERATOR

S/T
DIRECTOR OF WATER AND SEWERAGE SERVICES