


OPTIONAL= 1/2"Ø HOLE 1-3/4" FROM TOP OF BOX DRILLED OR FABRICATED AS NEEDED FOR CABLE CONDUIT IF NECESSARY FOR RADIO READ UNIT.

METER BOX MUST BE APPROVED CONCRETE DESIGN WITH CONCRETE BASE. BRICK CONSTRUCTION MAY BE USED WITH PRE APPROVAL FROM METRO WATER SERVICE.

PLAN

REFERENCE DETAIL AS REQUIRED FOR RADIO READ UNIT LOCATION IN FRAME AND COVER. ONLY ONE FRAME AND COVER MAYBE REQUIRED RADIO READ READY.

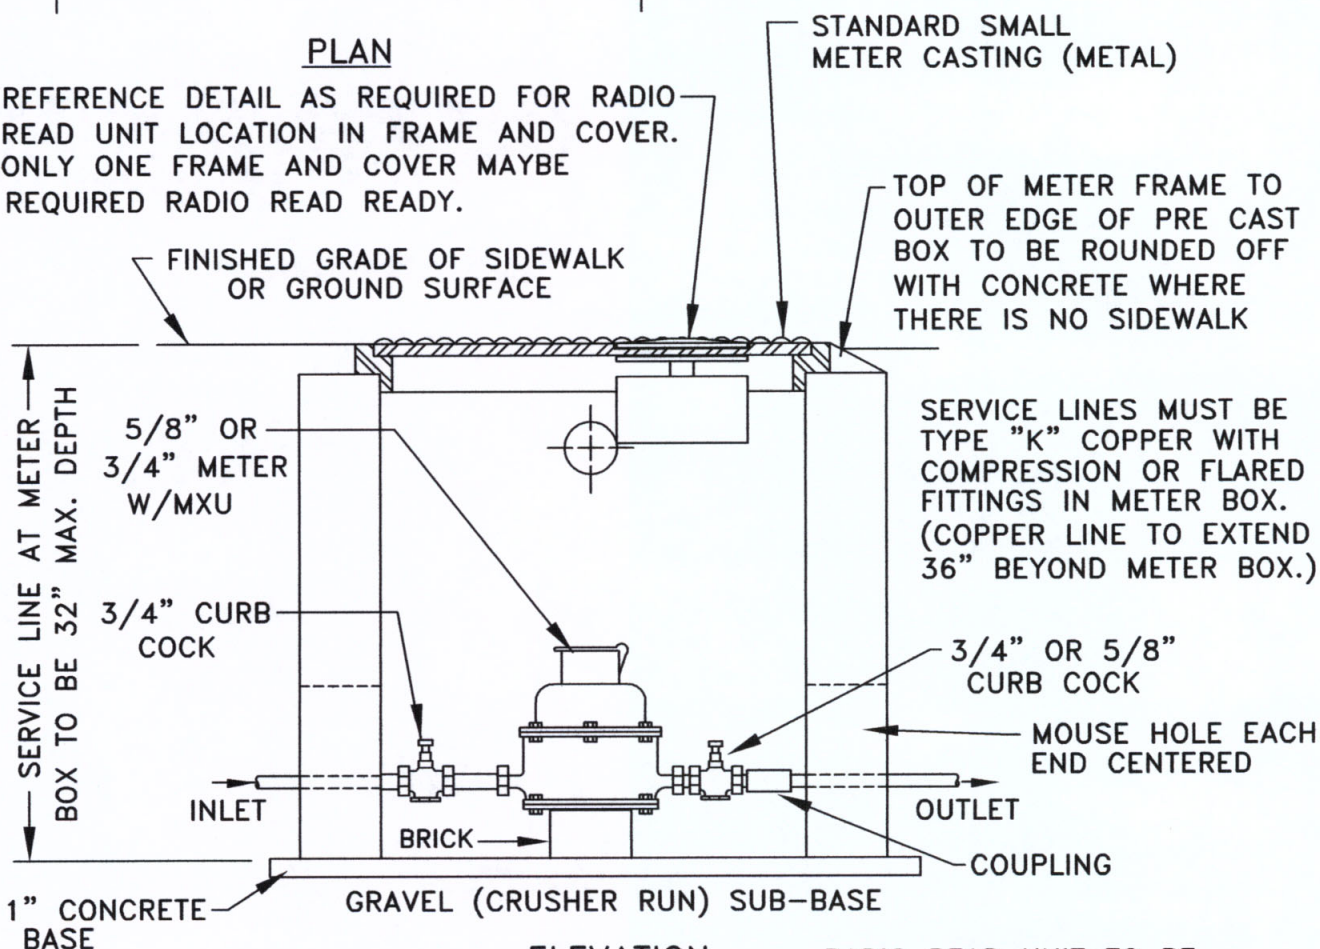

ELEVATION

CONCRETE: 4500 PSI @ 28 DAYS

RADIO READ UNIT TO BE INSTALLED AS PER MANUFACTURES SPECIFICATIONS.

RADIO READ UNIT TO BE INSTALLED ON SERVICE LINES AS INDICATED BY METRO WATER SERVICE PERMIT OFFICE.

METRO WATER SERVICES

STANDARD 5/8" OR 3/4" METER AND BOX DETAIL

NOT TO SCALE DATE: 05/05/08

DWG. NO. WDET002



Hal Balthrop
LICENSED DISTRIBUTION OPERATOR

Spitt
DIRECTOR OF WATER AND SEWERAGE SERVICES