


- Ⓐ 2" VALVE DOUBLE GATE IRON BODY OPEN LEFT
- Ⓑ 1-1/2" OR 2" METER WITH FLANGE CONNECTION 2" TEST TEE OF BRASS
- Ⓒ 2" x 6" BRASS NIPPLE & 2" BRASS GATE VALVE
- Ⓓ 2" BRASS CHECK VALVE AS PER METRO WATER (ONLY IF BACKFLOW ARE NOT AT METER BOX)
- Ⓔ 2" COPPER
- Ⓕ STRAINER REQUIRED WHEN TURBINE METER USED

3 SMALL STANDARD CASTINGS - 2" METER

REFERENCE DETAIL AS REQUIRED FOR RADIO READ UNIT LOCATION IN FRAME AND COVER. ONLY ONE FRAME AND COVER MAYBE REQUIRED RADIO READ READY.

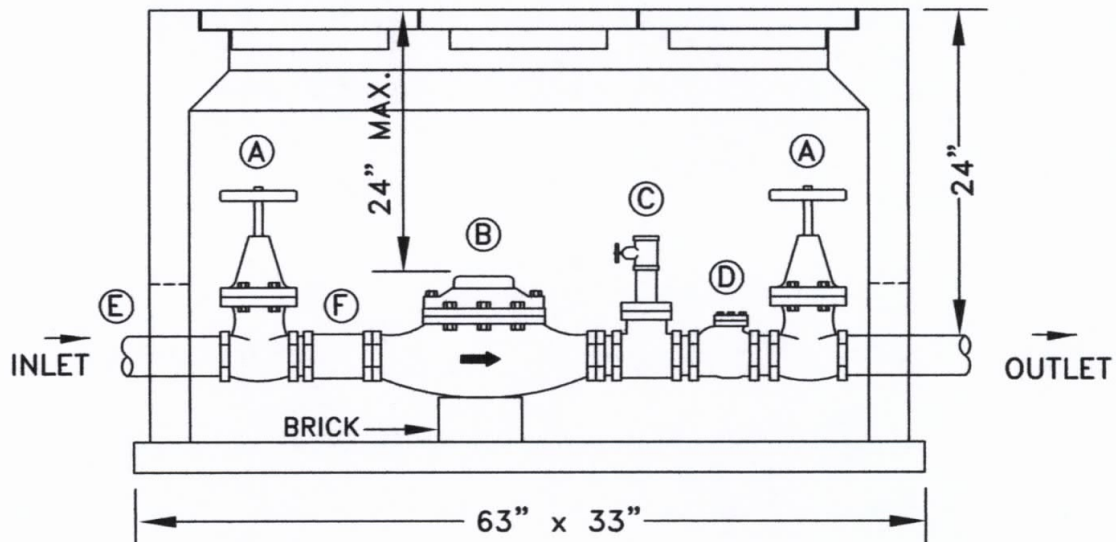

RADIO READ UNIT TO BE INSTALLED ON SERVICE LINES AS INDICATED BY METRO WATER SERVICES PERMIT OFFICE.

CONCRETE: 4500 PSI @ 28 DAYS REINFORCED WITH #3 BARS

RADIO READ UNIT TO BE INSTALLED AS PER MANUFACTURES SPECIFICATIONS.

METRO WATER SERVICES

METER INSTALLATION FOR
1-1/2" OR 2" METERS

NOT TO SCALE DATE: 03/18/15

DWG. NO. WDET018A



Hal Balthrop
LICENSED DISTRIBUTION OPERATOR

8/1/15

DIRECTOR OF WATER AND SEWERAGE SERVICES