


PLAN

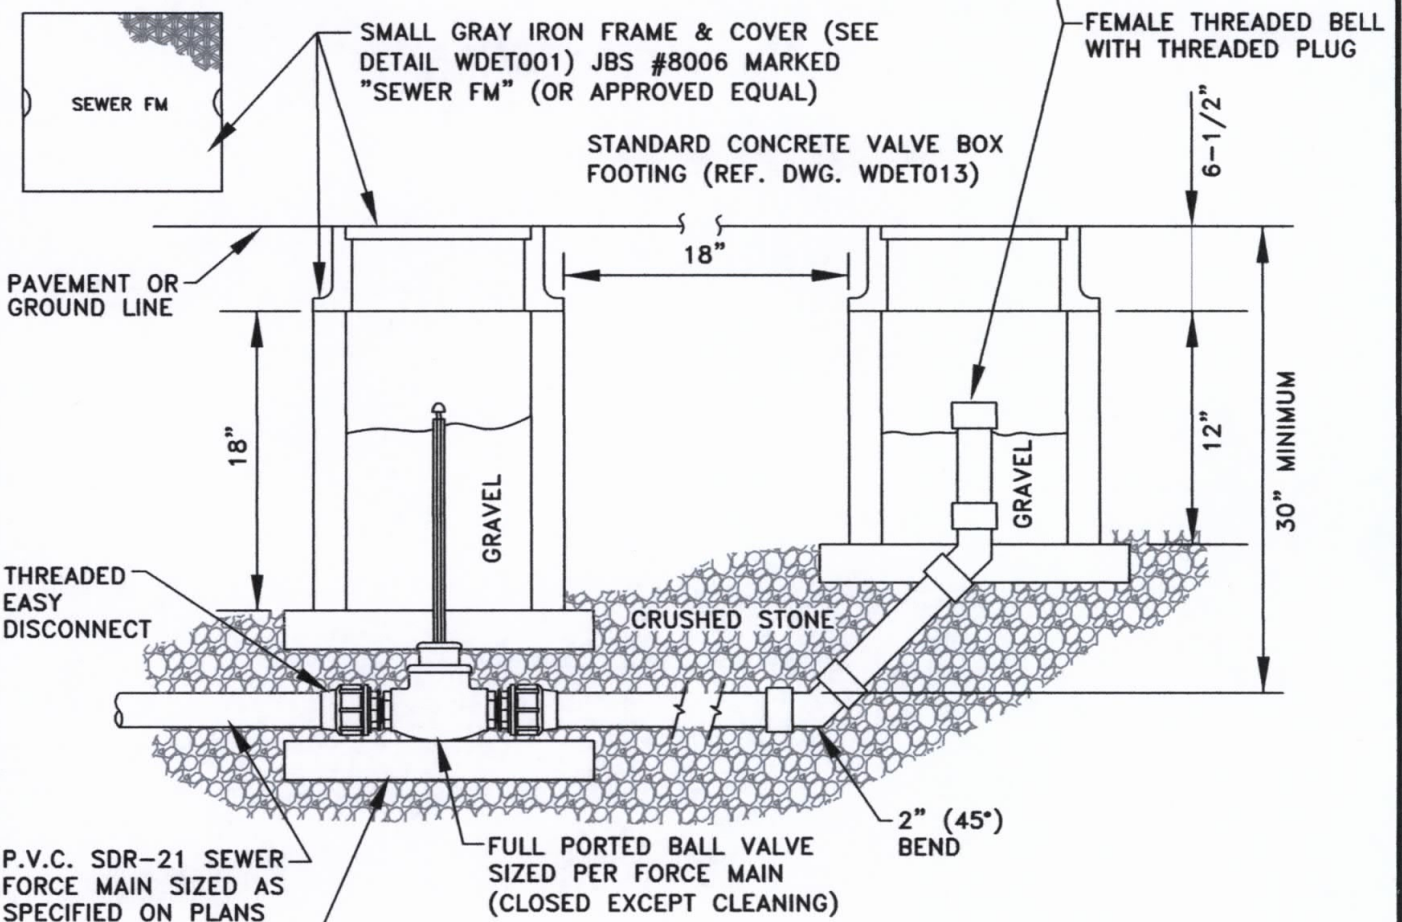

ELEVATION

MATERIALS MAY VARY AS APPROVED
BY METRO WATER SERVICE ENGINEER.

NOTE: (FORCE MAIN INSIDE R.O.W.)
CLEAN-OUT FORCE MAIN ASSEMBLY
SHALL BE OF 2" CONSTRUCTION.
WHEN FORCE MAIN IS LESS THAN
2", CLEAN-OUT TO MATCH FORCE
MAIN BEING CONSTRUCTED.

METRO WATER SERVICES

**GRINDER PUMP SYSTEM
VALVE AND CLEAN-OUT ASSEMBLY
FOR END OF FORCE MAIN**

NOT TO SCALE DATE: 03/18/15

DWG. NO. GP-5A

METRO
WATER SERVICES

Hal Balthrop
LICENSED COLLECTION OPERATOR
8/15

DIRECTOR OF WATER AND SEWERAGE SERVICES