


MIN. ELEV. \_\_\_\_\_ BUT NOT LESS  
THAN 9.0' ABOVE GROUND SURFACE.

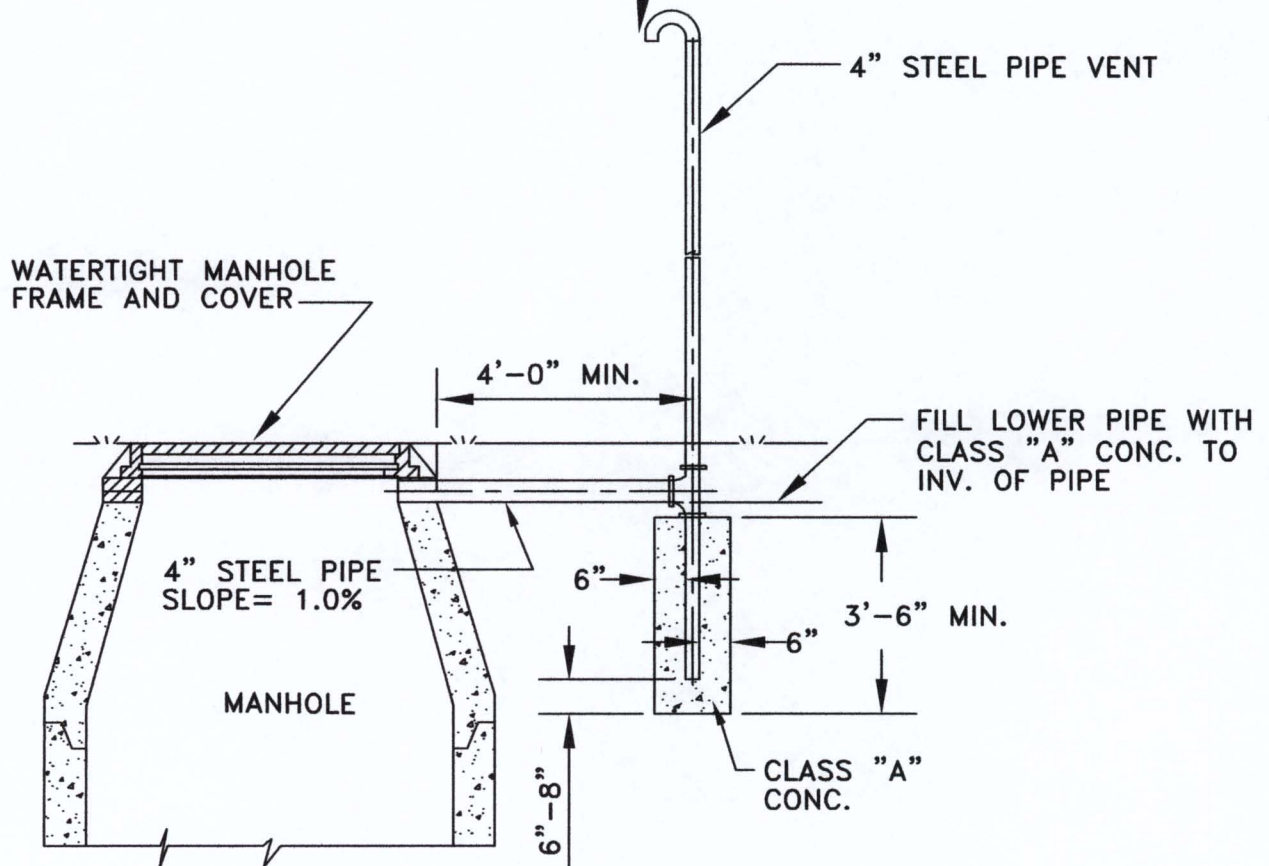

VENT PIPE SHALL BE LOCATED OUT OF A TRAVEL WAY, IN BACK OF A CURB OR SIDEWALK, OR AS CALLED FOR ON PLANS. PIPE SHALL BE PAINTED WITH A PRIME COAT OF ALUMINIUM EPOXY MASTIC 5.0 MILS D.F.T., INTERMEDIATE COAT TO BE AN CROSS-LINKED EPOXY 4.0-6.0 MILS D.F.T., TOP COAT SHALL BE AN ALIPHATIC POLYURET-HANE 3.0-5.0 MILS D.F.T., FOR A TOTAL 12.0 MILS D.F.T. MINIMUM. TOP COAT OF PAINT COLOR SHALL BE DARK GREEN.

METRO WATER SERVICES

VENT PIPE ASSEMBLY DETAILS

NOT TO SCALE | DATE: 02/22/08

DWG. NO. SDET004



*Hal Balthrop*  
LICENSED COLLECTION OPERATOR

*[Signature]*  
DIRECTOR OF WATER AND SEWERAGE SERVICES