

NOTES:


ALL COMPONENTS FOR HANGING A PIPELINE ON A BRIDGE SHALL BE MINIMUM TYPE 304 STAINLESS STEEL.

IF CONCRETE COMPRESSIVE STRENGTH TEST IS LESS THAN 4,000 PSI, ROLLER ASSEMBLIES SHALL BE INSTALLED WITH A MAXIMUM SPAN NOT TO EXCEED 6' BETWEEN ASSEMBLIES.

ROLLER ASSEMBLY SPACING:

ROLLER ASSEMBLIES TO BE INSTALLED 2' TO 4' EITHER SIDE OF THE BELL FACE WITH AN MAXIMUM SPAN NOT TO EXCEED 8' BETWEEN ASSEMBLIES.

INSTALL IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.

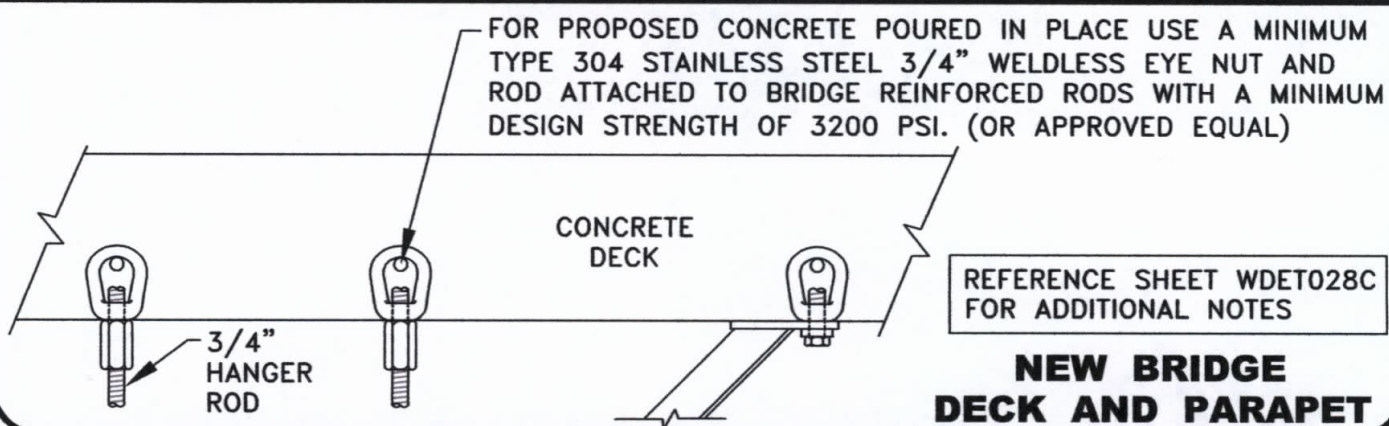

METRO WATER SERVICES

INSTALLING PIPELINE UNDER BRIDGE
STRUCTURE WITH DOUBLE ROLLER
ASSEMBLY AND HORIZONTAL SUPPORT

NOT TO SCALE | DATE: 06/26/14

DWG. NO. WDET028



Hal Batchelor
LICENSED DISTRIBUTION SYSTEM OPERATOR

Sft

DIRECTOR OF WATER AND SEWERAGE SERVICES