


PLAN

THE ASSEMBLY SHALL BE INSTALLED WITH SUFFICIENT CLEARANCE FOR MAINTENANCE.

INSTALL WITH LATEST CODES AND MANUFACTURES SPECIFICATIONS.

BALL CURB VALVE TO BE RATED FOR MAXIMUM LINE PRESSURE.

PRESSURE REDUCING VALVE TO BE WILKINS (ZURN) SERIES 70 (DOUBLE UNION FNPT) OR SERIES 610 (DOUBLE UNION FNPT) (OR APPROVED EQUAL)

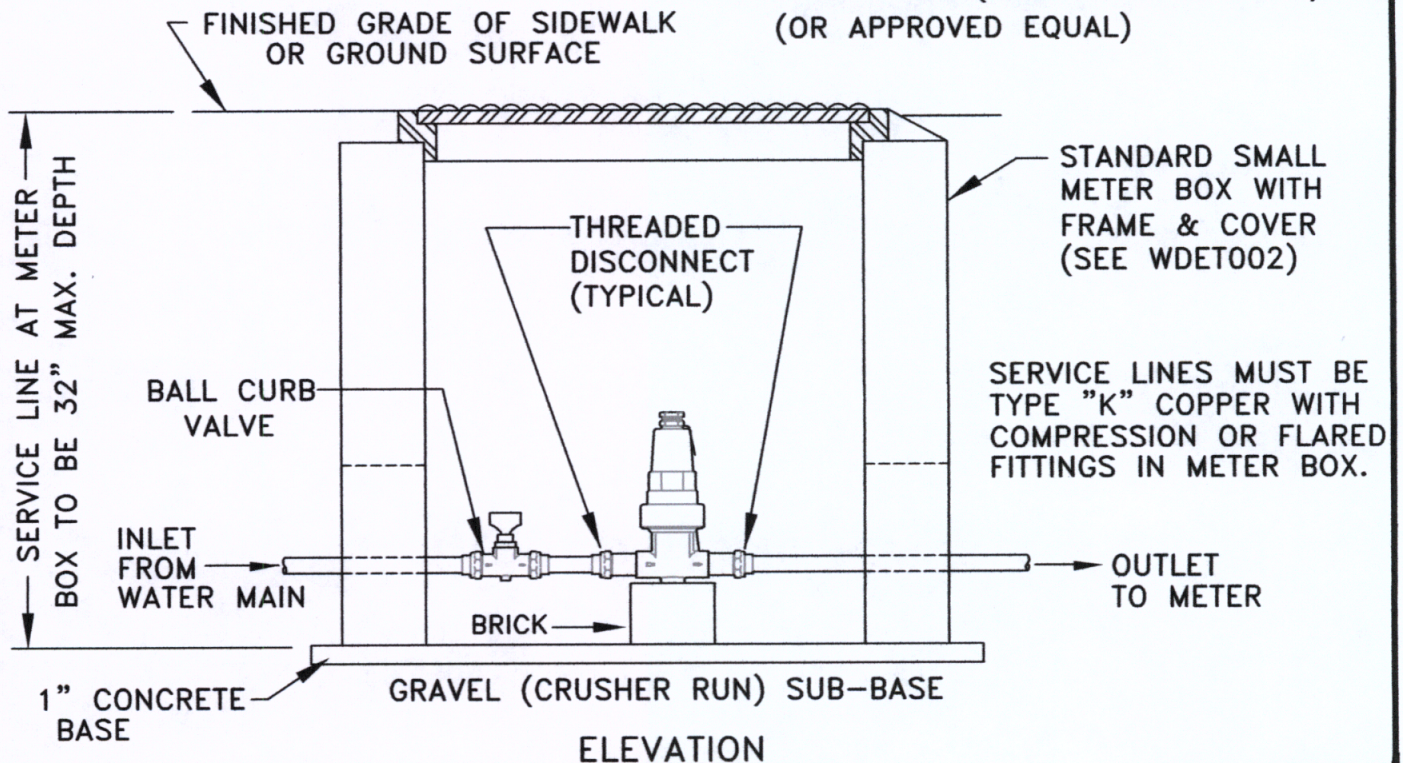

SERVICE LINES MUST BE TYPE "K" COPPER WITH COMPRESSION OR FLARED FITTINGS IN METER BOX.

METRO WATER SERVICES

**REDUCED PRESSURE VALVE
FOR 3/4" OR 1" LINE**

NOT TO SCALE | DATE: 11/08/13

DWG. NO. WDET0041



Hal Balthus
LICENSED DISTRIBUTION SYSTEM OPERATOR

WHS

DIRECTOR OF WATER AND SEWERAGE SERVICES