


COVER MARKED AS SHOWN

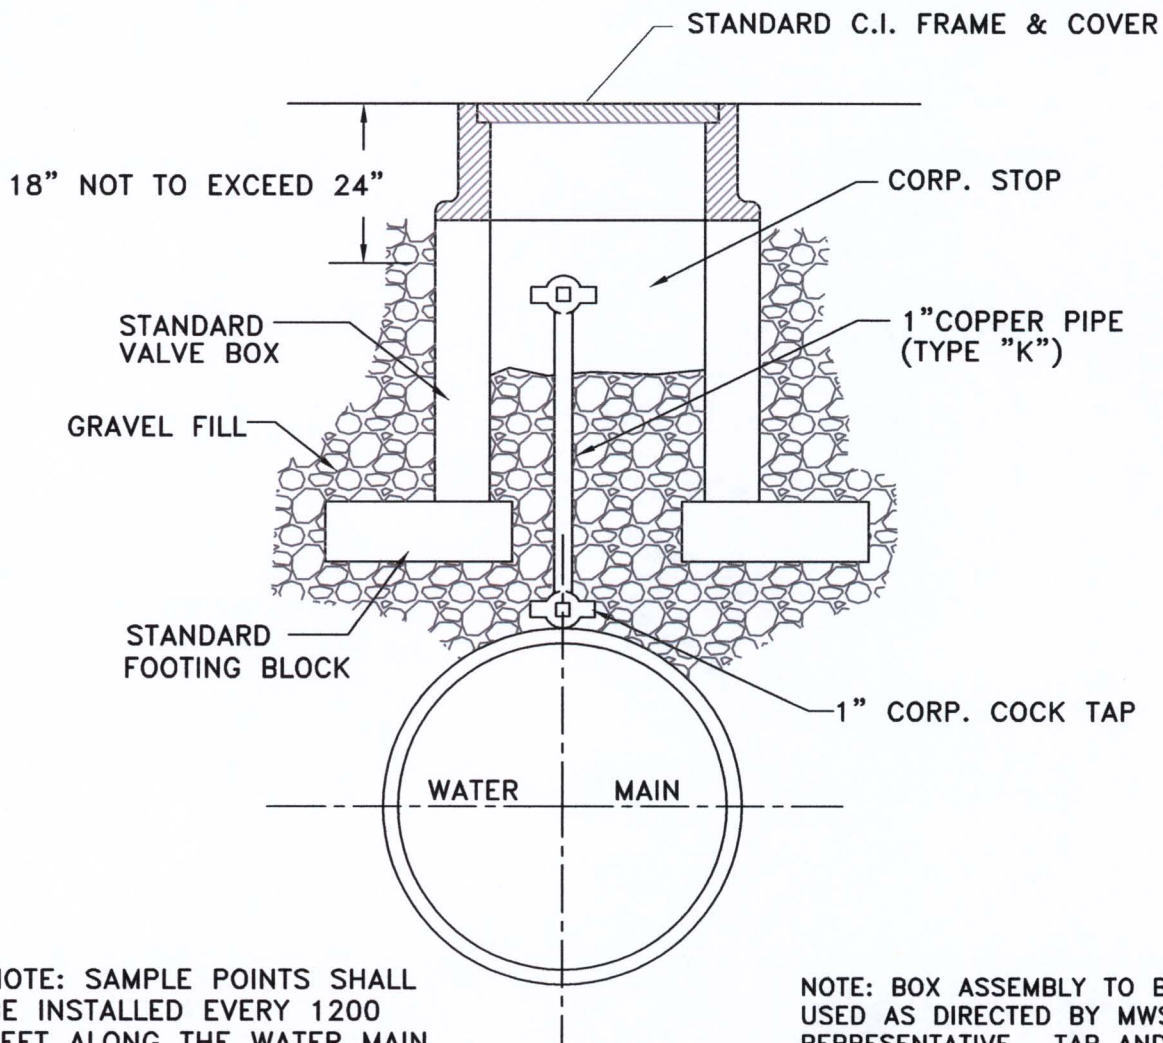

NOTE: SAMPLE POINTS SHALL BE INSTALLED EVERY 1200 FEET ALONG THE WATER MAIN BEING INSTALLED, OR AS DIRECTED BY MWS REPRESENTATIVE.

NOTE: BOX ASSEMBLY TO BE USED AS DIRECTED BY MWS REPRESENTATIVE. TAP AND BOX TO BE REMOVED AFTER SAMPLE HAS BEEN PERFORMED UNLESS OTHERWISE NOTED ON PLANS.

**METRO WATER SERVICES**

**STANDARD SAMPLE POINT**

NOT TO SCALE | DATE: 02/22/08

DWG. NO. WDET035



*Hal Battthrop*  
LICENSED DISTRIBUTION OPERATOR

*S. Pitt*  
DIRECTOR OF WATER AND SEWERAGE SERVICES