


PLAN

THE ASSEMBLY SHALL BE INSTALLED WITH SUFFICIENT CLEARANCE FOR MAINTENANCE. INSTALL WITH LATEST CODES AND MANUFACTURES SPECIFICATIONS.

BALL CURB VALVE TO BE RATED FOR MAXIMUM LINE PRESSURE. PRESSURE REDUCING VALVE TO BE IN ACCORDANCE WITH METRO WATER SERVICE APPROVED MATERIAL LIST.

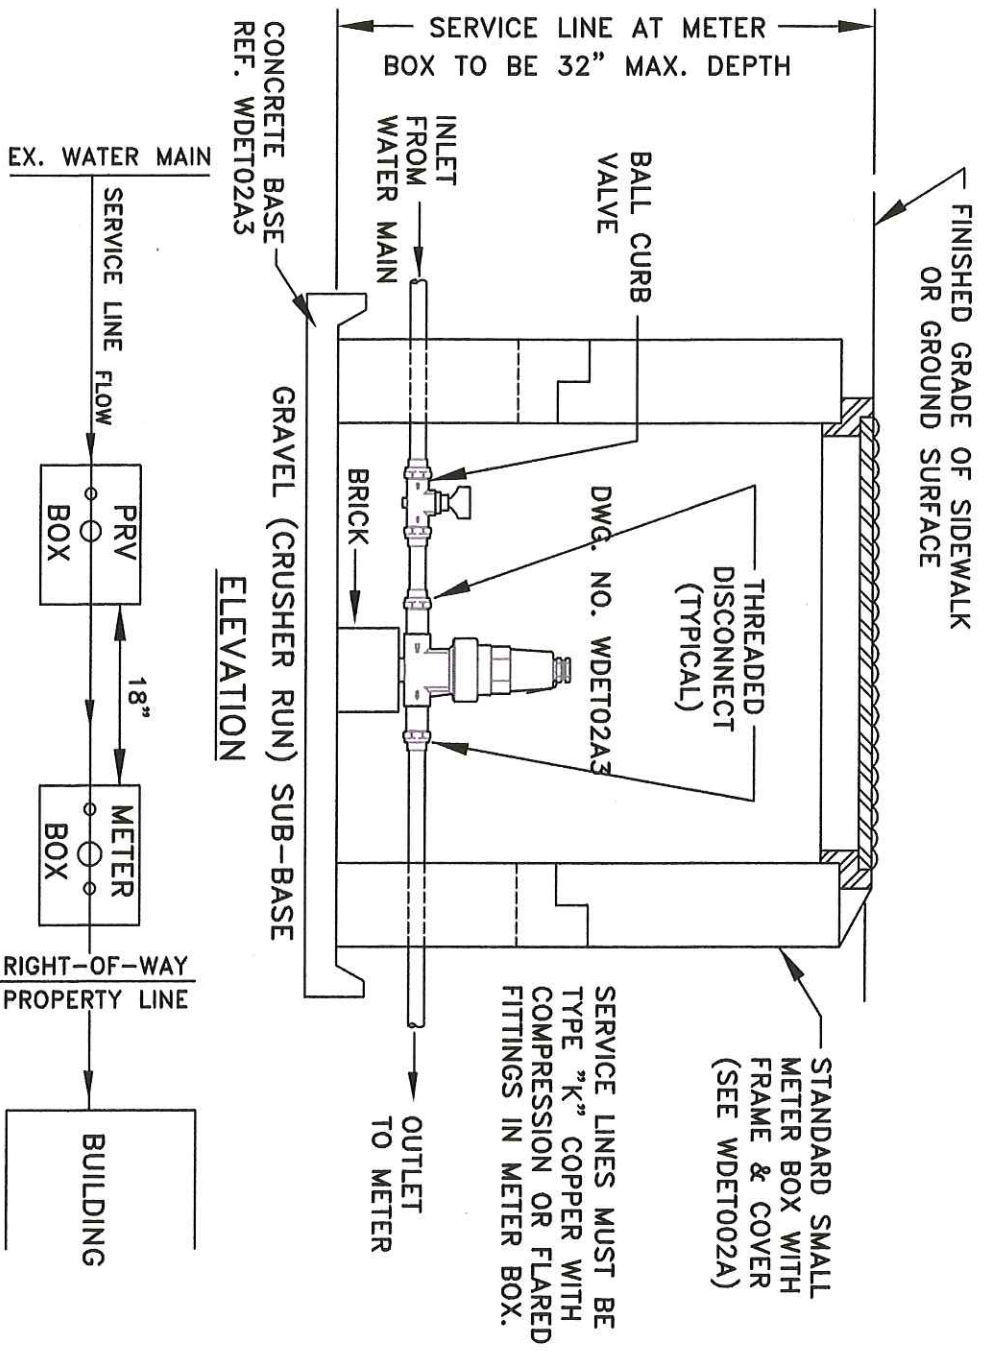

METRO WATER SERVICES

REDUCED PRESSURE VALVE
FOR 3/4" OR 1" LINE

NOT TO SCALE DATE: 09/04/14

DWG. NO. WDETPRV041



LICENSED DISTRIBUTION SYSTEM OPERATOR

Hal Balthrop

DIRECTOR OF WATER AND SEWERAGE SERVICES